


ELATION ELAR Q1 - (30) UNIT SYSTEM INSTALL DIAGRAM EXAMPLE

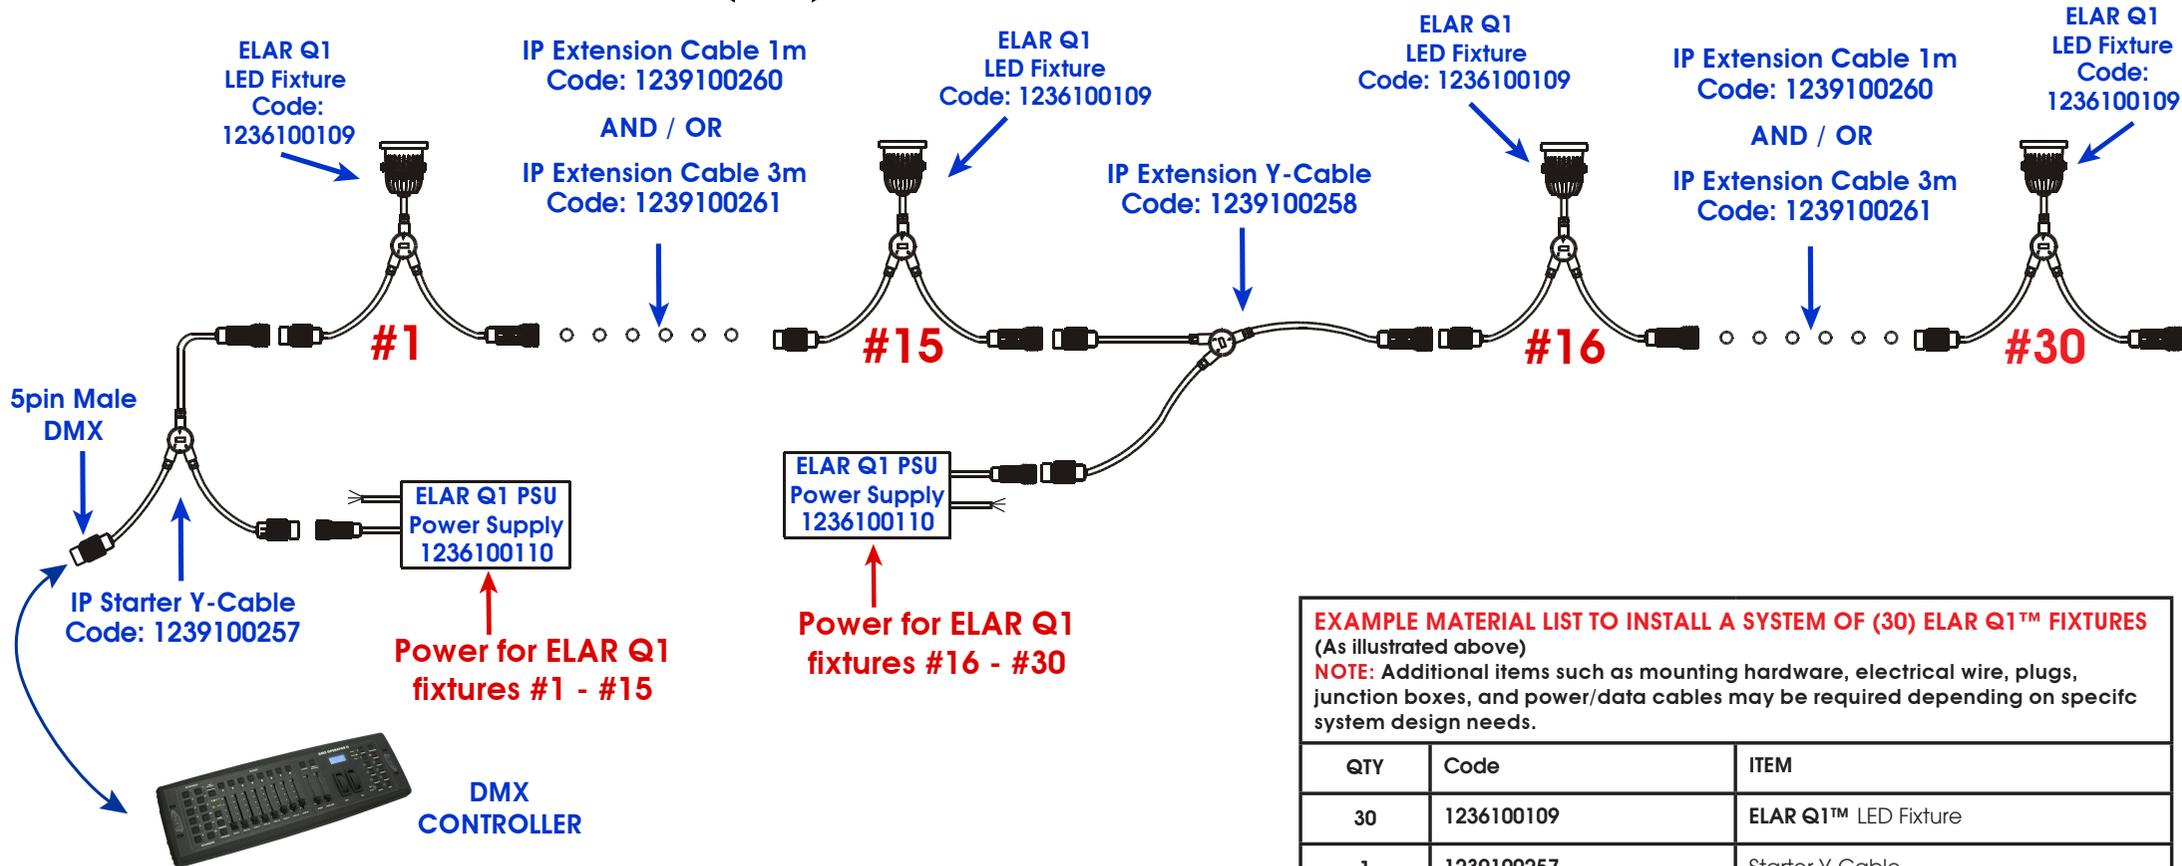

NOTES...

*Maximum of (15) ELAR Q1 fixtures per each ELAR Q1 PSU. (as illustrated above)

*ELAR Q1 PSU

NO POWER PLUG ATTACHED - BARE WIRE LEADS

Due to varying installation requirements, (3) bare-wire leads (Positive, Negative, Ground) are exposed, which can be wired to a standard electrical plug and/or wired into an IP rated electrical junction box.

*An RDM (Remote Device Management) supported device (not included) is required to change the DMX address on each ELAR Q1.

EXAMPLE MATERIAL LIST TO INSTALL A SYSTEM OF (30) ELAR Q1™ FIXTURES
(As illustrated above)
NOTE: Additional items such as mounting hardware, electrical wire, plugs, junction boxes, and power/data cables may be required depending on specific system design needs.

QTY	Code	ITEM
30	1236100109	ELAR Q1™ LED Fixture
1	1239100257	Starter Y-Cable
1	1239100258	Extension Y-Cable
2	1236100110	ELAR PSU 10™ Power Supply
OPTIONAL ITEMS TO SUPPORT ADDITIONAL FIXTURES AND/OR DISTANCES (Depending on system design)		
~	1236100110	ELAR PSU 10™ Power Supply
~	1239100257	Starter Y-Cable
~	1239100258	Extension Y-Cable
~	1239100260	1m Power/Data Ext.Cable
~	1239100261	3m Power/Data Ext.Cable